

1 Functional description

The empty housing module XI842000 is used as placeholder for 20 mm modules within a ctrlX I/O station. The module is designed without state display and without removable periphery plug and is not a device in the local bus.

The logic and peripheral voltage supply as well as the EtherCAT-based module communication are routed through the module.



Fig. 1: Module XI842000

For an application manual of the ctrlX I/O modules, refer to the media directory www.boschrexroth.com/mediadirectory and enter the search term "R911423458".

Ensure that the current documentation is consulted. For the current documentations, go to www.boschrexroth.com/mediadirectory and enter the module type as search term.

For the integration into the parent system, the respective ESI files are available. For the ESI files, go to <http://www.boschrexroth.com/electrics>, search term "ESI-Files".

2 Ordering data

Type	Part number	Description
XI842000	R911406128	Empty housing module 20 mm

3 Technical data

3.1 General technical data

XI842000	
Local bus connection	Passive module, no device at the local bus
Dimensions	20 mm × 105 mm × 85 mm (width × height × depth)
Weight	86 g (module including connector)
Electrical isolation	DC 1200 V U_P to U_L , DC 707 V U_P/U_L to FE, tested for 60 s each (not evaluated by UL)
EMC resistance	Acc. to EN 61000-6-2 and EN 61000-6-4
Mounting position	Vertical, on a horizontal mounting rail
Labeling, approvals	CE, UKCA, UL

3.2 Internal schematic diagram

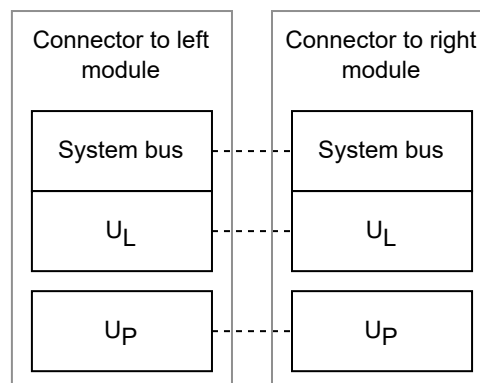


Fig. 2: Internal schematic diagram

3.3 Ambient conditions

Ambient temperature	
≤ 2,000 m	-25 to +55 °C
2,000 m to 3,000 m:	-25 to +50 °C
3,000 m to 4,000 m:	-25 to +45 °C
4,000 m to 5,000 m:	-25 to +40 °C
Maximum operating altitude	5,000 m
Acc. to DIN 60204	
Ambient temperature (storage and transport)	-40 to +70 °C
Permitted air humidity according to DIN EN 61131-2 (Operation, storage, transport)	10 to 95 %
Degree of protection	IP20
Acc. to DIN EN 60 529	(not evaluated by UL)
Protection class	III
Acc. to DIN EN 61010-2-201	
Overvoltage category	2
Acc. to IEC 60664-1	
Contamination level	2, no condensation
Acc. to EN 61010-1	

NOTICE**Defective device due to contaminated air!**

- The ambient air must not contain acids, alkaline solutions, corrosive agents, salts, metal vapors and other electrically conductive contaminants in high concentrations.
- The devices to be installed into the housings and installation compartments must at least comply with the degree of protection IP 54 according to DIN EN 60529.
- The device shall be provided in a suitable fire enclosure in the end-use application.

NOTICE**Defective device due to gases jeopardizing functions**

Due to the risk of corrosion, avoid sulphureous gases (e.g. sulphur dioxide (SO₂) and hydrogen sulphide (H₂S)). The device is not resistant against these gases.

NOTICE**Defective device due to overheating**

To avoid overheating and to ensure a trouble-free operation of the device, the ambient air has to circulate. Also refer to the section "Installation notes".

3.4 Mechanical tests

Vibration resistance Acc. to DIN EN 60068-2-6	Oscillations, sinusoidal in all three axes, 5 Hz - 8,4 Hz with 3.5 mm amplitude 8.4 Hz -150 Hz with 1 g peak acceleration
Shock test Acc. to DIN EN 60068-2-27	Shock stress: Shock resistance in all three axes 11 ms semi-sinusoidal 15 g
Broadband noise Acc. to DIN EN 60068-2-64	20-500 Hz with 1.22 g RMS (Root Mean Square), 30 min in all three axes

For the current approvals, go to
www.boschrexroth.com/electrics.

4 For your safety

4.1 Intended use

Use the module only as specified in the data sheet.

4.2 User qualification

The product use described in this data sheet is only intended for qualified electricians and staff trained by these qualified electricians. The user has to be familiar with the known safety concepts on automation technology, applicable standards and other guidelines.

4.3 Electrical safety

NOTICE**Loss of electric safety**

Unintended handling can affect the device safety! Observe the notes in the present data sheet during installation, commissioning and operation.

5 Installation

5.1 Maximum number of passive modules

Passive modules are not devices at the local bus. This means that the bus signals are not processed in these modules.

To ensure the transmission quality, up to three passive modules may be plugged in one after the other. Subsequently, at least one active module with a local bus device has to be installed again before the next passive module may be set.

5.2 Mounting and installation

The application manual for the ctrlX I/O modules contains notes on installation, mounting and dismounting. For the application description, go to:

- www.boschrexroth.com/MediaDirectory,
Search term: "R911423458"
or
- <https://docs.automation.boschrexroth.com/doc/4126711705/ctrlx-i-o-anwendungsbeschreibung/latest/en/>.


NOTICE**Destruction of the device due to non-compliance with the application manual**

Follow the mounting instructions in the application manual to ensure a correct mounting and to prevent damage to the device.

NOTICE**Device destruction due to electrostatic discharge**

The device contains components that can be damaged or destroyed by electrostatic discharge. Comply with the required safety measures against electrostatic discharge (ESD) acc. to EN 61340-5-1 when operating the module.

- Mounting location
The module has the degree of protection IP 20 and is thus intended for use in a closed control cabinet or control box (terminal box) with the degree of protection IP 54 or higher. The control cabinet fulfills the function of the final safety enclosure. The modules must be installed in the final safety enclosure. They have to be provided with sufficient rigidity according to UL 61010-1, 61010-2-201 and have to meet the requirements with regard to fire propagation.
- End clamps
Fasten end clamps of the type SUP-M01-ENDHALTER (R911170685) on both sides of the station. End clamps ensure the correct fastening on the support rail and are used as lateral end elements. Always fasten one end clamp of the station before mounting the station. This ensures the following:
 - It impedes the shifting of the modules
 - The installation place for the end clamp is secured.
- Endcover
At the end of each ctrlX I/O station, slide an endcover of type XACC-2-END-COVR onto the last module. The endcover is included in the scope of delivery of the bus coupler. Sliding on the endcover ensures protection against accidental contact.
- Mounting rail
Mount the module on a 35 mm standard support rail. Use only a TH 35-7.5 support rail acc. to EN 60715. The fastening distance of the support rails may not exceed 200 mm. This distance is required to ensure stability while mounting and dismounting the module.



- Provide the following minimum distances for sufficient cooling:

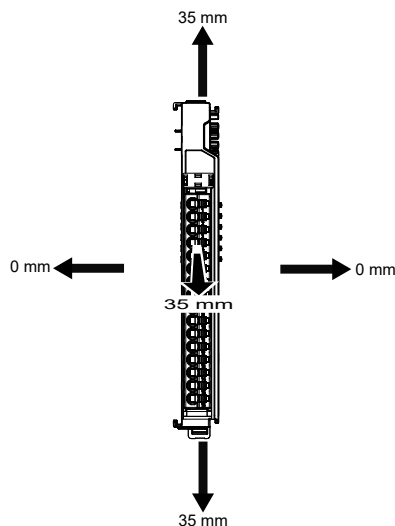


Fig. 3: Ventilation distances

- Additionally, provide sufficient distance for mounting, dismounting, plugs and cables.
- If more devices are connected in series to the station on the left or right, the surface temperature may not exceed 60° C
- In case of a several line design, the supply air has to be measured under each line and its limit value may not be exceeded. For permitted values, refer to the chapter "Ambient conditions" of the respective module data sheet.

5.2.1 Mounting the ctrlX I/O module

NOTICE

Damage of the device by plug mounting under voltage!

Disconnect the module and all connected module components from voltage before mounting or dismounting.

NOTICE

Damage of the device by short circuit of patch connectors

There is an endcover on the right upon delivery of the bus coupler. Remove this endcover to connect the modules at the bus coupler in series. Position the endcover on the last module of the station to protect it against short circuit and contamination.

NOTICE

Possible damage to property due to unintended mounting of the support rail

- Connect the support rail to a functional earth.
- Mount the module on a support rail.
- Install the module in a control cabinet or in an appropriate housing.

NOTICE

Module is not fixed correctly due to open support arm mounting!

Before mounting, ensure that the support arm mounting of the control is not in open position. If required, release the clamping of the open position using the locking lever, refer to the following figure Fig. 4.

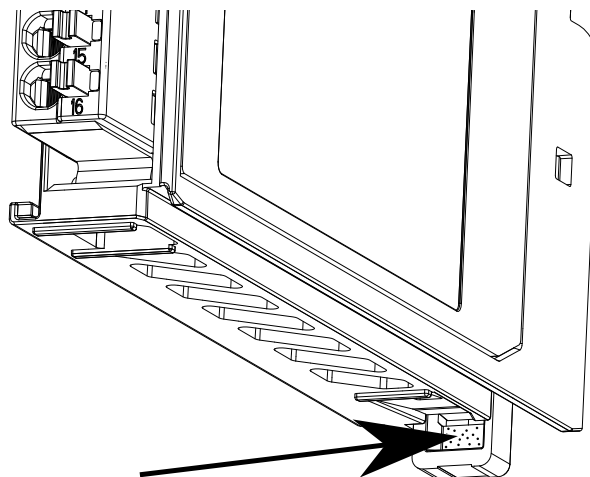


Fig. 4: Locking lever to release the clamping of the open position.

Each module has to be snapped separately.

5.2.2 Positioning plug

1. Position the plug on the connector holder, see ①.
2. The plug engages at the locking lever, see ②

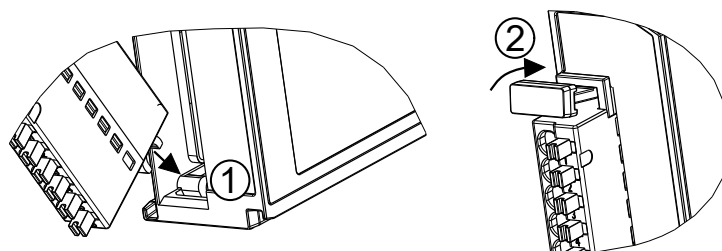


Fig. 5: Positioning plug

5.2.3 Removing plug

1. Press the locking lever of the plug at the top, see ①
2. Remove the plug, see ②.

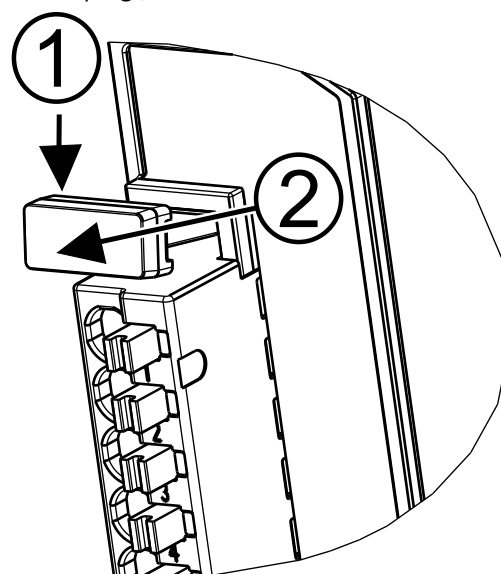


Fig. 6: Removing plug

5.2.4 Dismounting module

⚠ For dismounting, use a common tool such as a slotted screwdriver with a 2.5 mm blade.

NOTICE

Destruction of components and devices due to mounting and dismounting under voltage!

Disconnect the module and all connected module components from voltage before mounting or dismounting.

Removing module from support rail

- 1. Use a suitable tool (e.g. slotted screwdriver) and put it into the lower disengaging mechanism (base latch) of the module and disengage the module (see (A) in the following figure). The base latch is locked in the open position.
- 2. Remove the module vertically to the support rail [see (B) in the following figure].

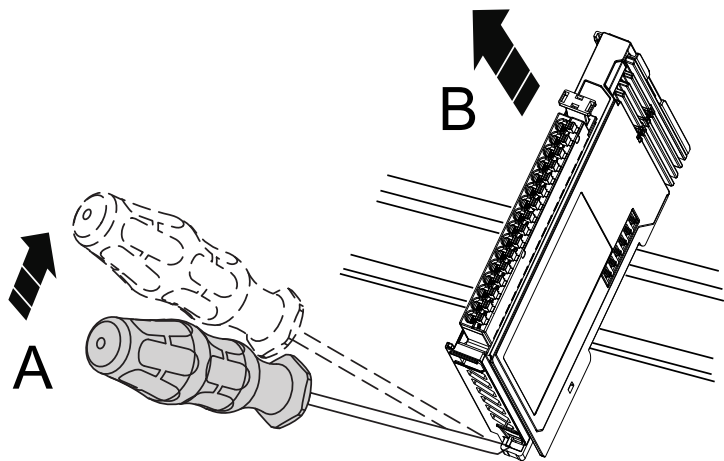


Fig. 7: Removing module from support rail

Before mounting the module on the support rail again, release the clamping of the open position again. Press the locking lever, refer to the figure Fig. 4.

5.2.5 Electric installation

Notes on the electrical connection

- To avoid EMC interferences due to loop formation, 24 V voltage potential and ground (GND) have to be connected in star shape from the 24 V power supply unit to the connections for logic voltage (U_L) and peripheral voltage (U_P).
- Use only insulated copper wires suitable for at least 75 °C.

Tools

- Use the "Phoenix Crimpfox 6" crimping plier to crimp wire end ferrules. The ordering number is: "1212034 Crimpfox 6" at Phoenix Contact.
- Use a slotted screwdriver with a 2.5 mm blade.

Permitted lines

- Rigid lines
Stripping length: 8.5 mm ±.5 mm, burr-free
- Flexible line without wire end ferrule
Stripping length: The length of the stripped and 360° twisted braids has to be 8.5 mm ±0.5 mm
- Flexible line with wire end ferrule
- Use a cable cross-section corresponding to the current (minimum 0.2 mm², maximum 1.5 mm²) to avoid an excessive increase in temperature. A cable cross-section of 1.5 mm² is specified for the power supply (U_P) of 8 A. The minimum cable cross-section for the power supply (U_L) is 0.75 mm².
- The insulation of the cables used has to correspond to the rated voltage.

Wire end ferrules

- Wire end ferrules with and without insulating collar are permitted with a contact length of 8 mm according to DIN 46228.
- Maximum dimensions of the crimped wire end ferrule:
Height 1.45 mm
Width 2.34 mm
- Twin wire end ferrules are not permitted.

Orientation of the wire end ferrules

- The orientation of the wire end ferrule in the clamping point has to be vertical.

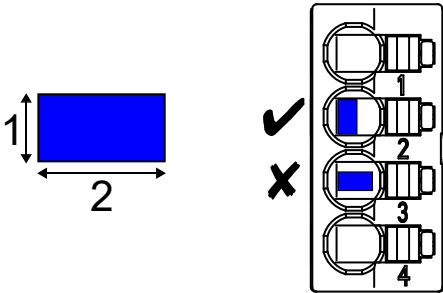


Fig. 8: Orientation of the wire end ferrules in the clamping point

- 1 Height of the crimped wire end ferrule
- 2 Width of the crimped wire end ferrule

Installing lines

- Press the pusher with a suitable slotted screwdriver.
- Insert the line into the clamping point as far as possible.
- Release the pusher.

Uninstalling lines

- Press the pusher with a suitable slotted screwdriver.
- Remove line.
- Release the pusher.

Mounting notes for UL certification

Permitted lines

- Use flexible lines with wire end ferrules for UL devices.
- The following wire end ferrules are permitted:
 - Wire end ferrules with insulating collar as per the table:

Cable cross-section in AWG	Cable cross-section mm ²	Ordering numbers of the wire end ferrules (Weidmüller company)
24 AWG	0.2 mm ²	9025760000, 500 pieces
22 AWG	0.35 mm ²	9025770000, 500 pieces
20 AWG	0.5 mm ²	0690700000, 500 pieces 1476230000, 100 pieces
18 AWG	0.75 mm ²	0462900000, 500 pieces 1476240000, 100 pieces
-	1 mm ²	0463000000, 500 pieces 1476250000, 100 pieces
16 AWG	1.5 mm ²	0463100000, 500 pieces 1476270000, 100 pieces

Orientation of wire end ferrules

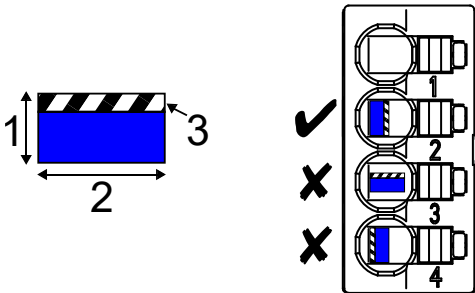


Fig. 9: Orientation of the wire end ferrules in the clamping point

- 1 Height of the crimped wire end ferrule
- 2 Width of the crimped wire end ferrule
- 3 Crimped side of the wire end ferrule

6 License information

6.1 EtherCAT®



The ctrlX I/O modules use EtherCAT® technology. "EtherCAT®" is a registered trademark and patented technology licensed by the Beckhoff Automation GmbH, Germany. EtherCAT is an open, internationally standardized standard and developed further by the "EtherCAT Technology Group" (ETG).

